


VIEW A-A

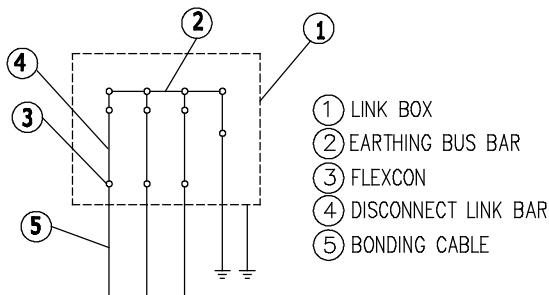

LIST OF MAIN PARTS

Item	Name of parts	Materials
1	CABINET (2 mm)	STAINLESS STEEL
2	CABLE FLEXCON	TINNED COPPER
3	SUPPORT INSULATOR	EPOXY
4	GLAND FOR BONDING CABLE	STAINLESS STEEL
5	GLAND FOR EARTHING CABLE	STAINLESS STEEL
6	DISCONNECTABLE EARTHING BAR (10x40)	TINNED COPPER
7	EARTHING BUS BAR (10x40)	TINNED COPPER
8	DISCONNECTABLE EARTHING BAR (10x40)	TINNED COPPER
9	BOX EARTHING BAR	STAINLESS STEEL
10	PROTECTION COVER	PLEXYGLASS
11	DOOR FIXING BOLTS	STAINLESS STEEL
12	PADLOCK FACILITY	STAINLESS STEEL
13	COVER (3 mm)	STAINLESS STEEL

Specifications	
Protection degree	IP66
DC Voltage test	25 kV-5 min.
Short circuit test	40 kA-1 sec.
Internal power arcing	40 kA-0,1 sec.
Impulse voltage between parts	N / A
Impulse voltage against earth	37,5 kV
*SA rate (Politek-PMSP)	N / A
Bonding cable (Single)	95-400 mm2
**Inner Core Insulation Dia.(Min.-Max.)	
**Screen Wires Dia.(Min.-Max.)	
**Outer Dia.(Min.-Max.)	ø17-ø40
Weight	app. 45 Kg.
Volume of Filling compound (optional)	
Colour	RAL 7032

*Indicate,if different SA (SVLs) required...

**Indicate,if bonding cable different size...

E	08.01.16	G.OZUCER	S.ERDENIZ	S.ERDENIZ	ADDED DISCONNECTABLE EARTHING BAR FOR EARTHING CABLE
D	30.12.15	G.OZUCER	S.ERDENIZ	S.ERDENIZ	COVER THICKNESS CHANGED
C	21.03.10	F.CABAROGLU	S.ERDENIZ	S.ERDENIZ	CABLE GLAND SEALING & MOUNTING DIMENSIONS CHANGED,BAR DIMENSIONS ADDED
B	21.04.08	F.CABAROGLU	S.ERDENIZ	S.ERDENIZ	DOOR FIXING BOLTS,CABLE CONNECTION & CABINET THICKNESS CHANGED
Rev.	Date	Drawn	Check	Apprv.	

Earthing Link Box		04.08.02		Rev. E	
FOR WALL TYPE		TYPE :LB.W.E.3.1		Drawn : 21.04.2008 / F.C.	
				Approved : 21.04.2008 / S.E.	