

Project:	V504/549 OPGW: TR Řípov – st.č. 5
Conductor / earth wire / OPGW	OPGW
Designation:	2S 2 / 24 (M167 / R91 – 228) - Ø 17,70 mm
Tension:	≤ 44,6MPa
At the request of:	EGEM s.r.o.
Date:	16.04.2024
Internal request:	2024_089

Index

1. Vibration damper types.....	1
2. Damper placement recommendation at tension tower	2
3. Damper placement recommendation at suspension clamps	3
4. Maximum span lengths protected	4

1. Vibration damper types

- Damper type 1 B853002A03 (consisting of damper B853002 and attachment rods TW184043)
- Damper type 2 B161003A05 (consisting of damper B161003 and attachment rods TW310062)

Richard Bergner

Elektroarmaturen GmbH & Co. KG

Registered office at Schwabach
 Amtsgericht Nürnberg HRA 18054
 Personally liable partner:
 Richard Bergner Elektroarmaturen Verwaltungs GmbH
 AG Nürnberg HRB 14827
 USt-ID-Nr.: DE188368425
 Steuernummer: 247/173/06704

www.ribe.de

Managing Directors:

Frank A. Bergner
 Thomas Dann
 Tolga Bayraktar

Address:

Norisstraße 24
 91154 Roth
 Germany

Telecommunication:


Phone +49 (0) 9122 / 87 -0
 Fax +49 (0) 9122 / 87 -1506
 E-Mail electrical-fittings@ribe.de

Bank Accounts:

Commerzbank Schwabach, Kto-Nr. 5 803 598, BLZ 760 400 61
 SWIFT: COBA DE FF 760 IBAN: DE29 7604 0061 0580 3598 00
 Deutsche Bank AG, Kto.Nr.: 750037400 BLZ: 76070012
 SWIFT: DEUTDEMM760 IBAN: DE91 7607 0012 0750 0374 00

Project:	V504/549 OPGW: TR Řípov – st.č. 5
Conductor / earth wire / OPGW	OPGW
Designation:	2S 2 / 24 (M167 / R91 – 228) - Ø 17,70 mm
Tension:	≤ 44,6MPa

2. Damper placement recommendation at tension tower

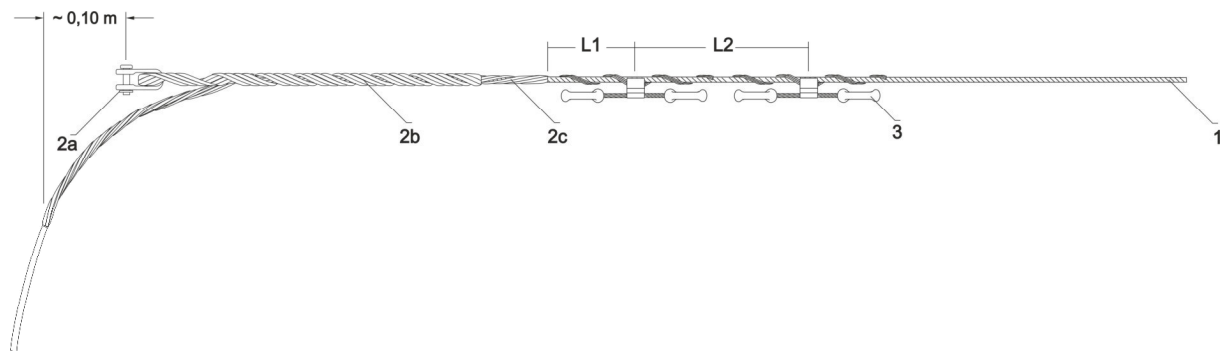

L1 = 0,5 m

L2 = 0,6 m


Not to scale

Tolerance for placement of dampers ±0,01 m

1	OPGW	2S 2 / 24 (M167 / R91 – 228) - Ø 17,70 mm
2	Dead end	Consisting of
2a	Thimble	F02686A02
2b	Dead end	AW252152
2c	Protection rod	RW193220lis
3	Vibration damper ID	B853002A03 (consisting of damper B853002 and attachment rods TW184043)

Project:	V504/549 OPGW: TR Řípov – st.č. 5
Conductor / earth wire / OPGW	OPGW
Designation:	2S 2 / 24 (M167 / R91 – 228) - Ø 17,70 mm
Tension:	≤ 44,6MPa

3. Damper placement recommendation at suspension clamps

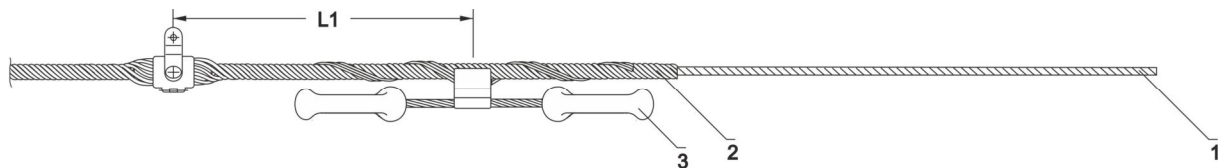

L1 = 0,6 m

Not to scale



Tolerance for placement of dampers ±0,01 m

1	OPGW	2S 2 / 24 (M167 / R91 – 228) - Ø 17,70 mm
2	Suspension clamp consisting of clamping unit armour rods	Armor grip suspension unit LTA179200.Li.S19 B801051-51A02 KA179200LIS
3	Vibration damper ID	B161003A05 (consisting of damper B161003 and attachment rods TW310062)



Project:	V504/549 OPGW: TR Řípov – st.č. 5
Conductor / earth wire / OPGW	OPGW
Designation:	2S 2 / 24 (M167 / R91 – 228) - Ø 17,70 mm
Tension:	≤ 44,6MPa

4. Maximum span lengths protected



Spans between tension clamps (TT - TT)


Span type	span length m	Damper type at span end	Diagram (not to scale)	Damper type at span end
TT – TT	≤ 240	2 x type 1		-
TT – TT	>240 – 313,9	2 x type 1		2 x type 1

Spans between suspension and tension clamps (ST - TT)

Span type	span length m	Damper type at span end	Diagram (not to scale)	Damper type at span end
ST – TT	≤ 240	-		2 x type 1
ST - TT	>240 – 313,9	1 x type 2		2 x type 1

Spans between suspension clamps (ST - ST)

Span type	span length m	Damper type at span end	Diagram (not to scale)	Damper type at span end
ST - ST	≤ 240	1 x type 2		-
ST - ST	>240 – 313,9	1 x type 2		1 x type 2

 tension clamp (TT),  suspension clamp (ST),  vibration damper

Damper type 1 B853002A03


Damper type 2 B161003A05

Damper distribution chart and quantities

2024_089



Project: V504/549 OPGW: TR Řípov – st.č. 5
OPGW: 1 x 2S 2 / 24 (M167 / R91 – 228) (Ø17,7)

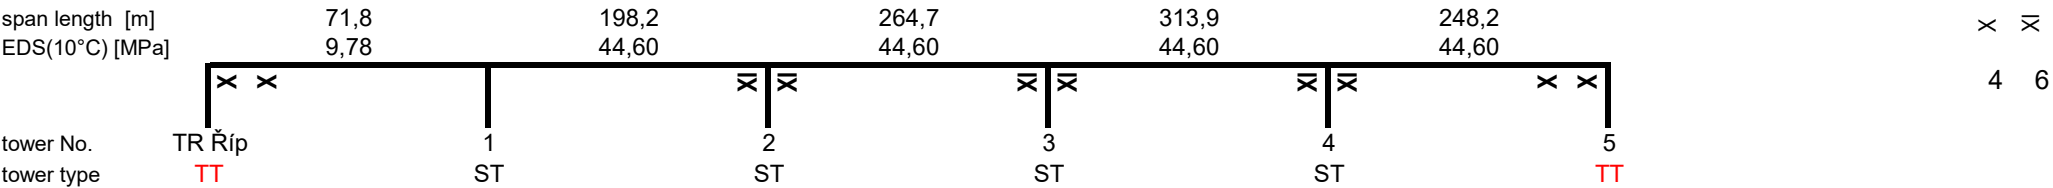

TT = tension tower
ST = suspension tower

\times = damper
 \boxtimes = damper on armour rods

total (1 x): 4 x B853002A03 (\times)
6 x B161003A05 (\boxtimes)

Information:
The installation instruction applies only to the line and dampers indicated above.